




Series  
CDT

# Carbon Dioxide/Temperature Transmitter

NDIR Sensor, Universal Outputs, Optional Relay

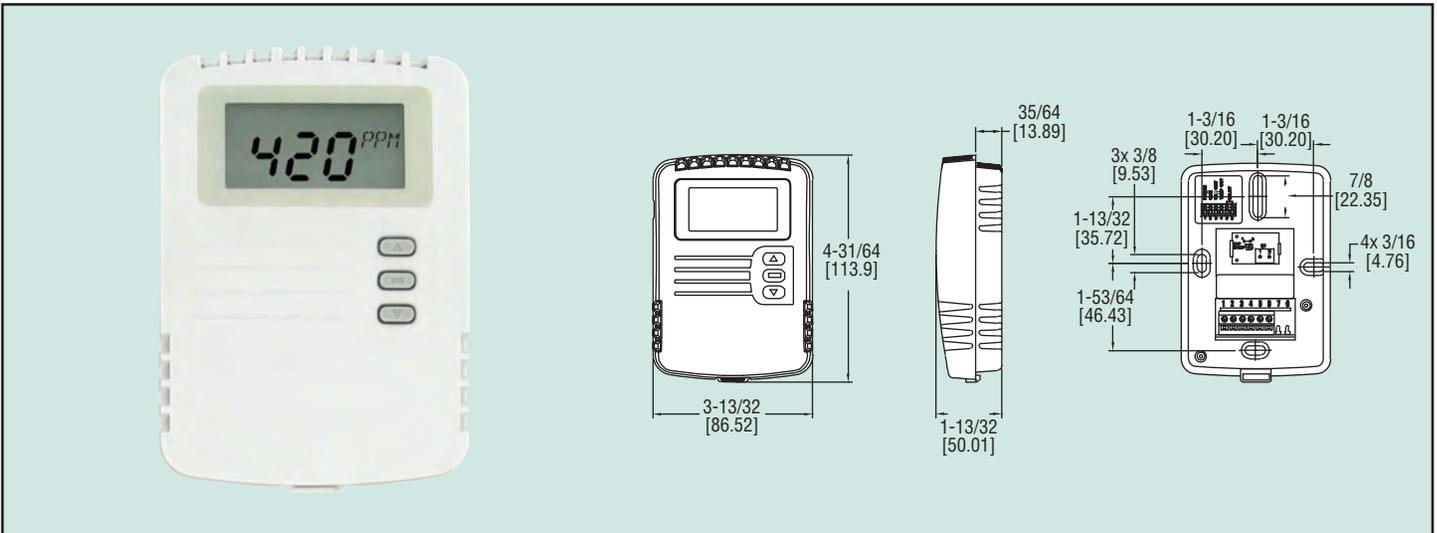

**Series CDT Carbon Dioxide and Temperature Transmitters** accurately monitor the CO<sub>2</sub> concentration and temperature in schools, office buildings, and other indoor environments to help achieve LEED® certification. For increased sensor life, a single-beam dual-wavelength non-dispersive infrared (NDIR) sensor is used to automatically correct the measurement in both occupied and unoccupied buildings against aging effects. The single-beam dual-wavelength sensor technology provides the highest level of accuracy compared to Automatic Baseline Correction methods which can unintentionally shift the calibration based on CO<sub>2</sub> levels and barometric pressure conditions. In order to achieve a higher level of accuracy, the Series CDT includes digital barometric pressure adjustment and the ability to field-calibrate the sensor.

Universal outputs allow users to select the transmitter output to be 4 to 20 mA, 0 to 5 VDC, or 0 to 10 VDC to work with virtually any building management controller. An optional relay with user adjustable set points can be used to control exhaust fans, open actuated windows or dampers, or signal a light or horn.

For applications that require visual indication, the Series CDT can be ordered with an integral LCD display or the Model A-449 remote LCD display that can plug into the mini-connector port on the side of the transmitter. The display can be configured to display temperature only, CO<sub>2</sub> only, or CO<sub>2</sub> and temperature together. Push buttons are standard on the transmitters for access to the menu structure, but the transmitter can be ordered without the buttons. To prevent tampering, the action of the buttons can be locked out using an internal jumper selection. Menu items that can be accessed include: engineering units, relay output set points, display configuration, transmitter output scaling, ambient barometric pressure, and field calibration of the transmitter.

**Single beam dual-wavelength sensor advantages:**

- Automatically corrects for aging effects in occupied and unoccupied buildings\*
  - Perfect for hospitals and manufacturing plants that are occupied 24 hours per day
- Measures actual unfiltered light intensity directly
  - Eliminates error from incorrect assumptions of gas concentration in theoretical logic assumption methods

\*For buildings occupied 24 hours per day, it is recommended that calibration be verified every 6 to 12 months depending on application.

**SPECIFICATIONS**

- Sensor:** Single beam, dual-wavelength NDIR.
- Range:**
  - CO<sub>2</sub>: 0 to 2000 or 0 to 5000 ppm (depending on model);
  - Temperature: 32 to 122°F (0 to 50°C).
- Accuracy:** ±40 ppm + 3% of reading.
- Temperature Dependence:** ±8 ppm/°C at 1100 ppm.
- Non-Linearity:** 16 ppm.
- Pressure Dependence:** 0.13% of reading per mm of Hg.
- Response Time:** 2 min for 99% step change.
- Temperature Limits:** 32 to 122°F (0 to 50°C).
- Humidity Limits:** 10 to 95% RH (non-condensing).
- Power Requirements:** 16 to 35 VDC or 19 to 28 VAC.
- Power Consumption:** Average: 2 w; Peak: 3.75 w.
- Output:**
  - Current: 4 to 20 mA (max. 500 Ω);
  - Voltage: 0 to 5 VDC or 0 to 10 VDC (min. 500 Ω);
  - Relay: SPST NO rated 2A @ 30 VDC;
  - RTD or thermistor per r-t curves (depending on model).
- Weight:** 5.6 oz (158.8 g).

Series	CDT	-2	W	4	4	-LCD	Example: CDT-2W44-LCD
<b>Range</b>		2					0 to 2000 ppm CO <sub>2</sub> range 0 to 5000 ppm CO <sub>2</sub> range
<b>Configuration</b>			W				Wall
<b>CO<sub>2</sub> Output</b>				4			4 to 20 mA / 0 to (5 or 10) VDC
<b>Temperature Output</b>					0		None
					4		4 to 20 mA / 0 to (5 or 10) VDC
					A		10 KΩ NTC thermistor type III
					B		10 KΩ NTC thermistor type II
					C		3 KΩ NTC thermistor
					D		Pt100 Ω RTD
					E		Pt1000 Ω RTD
					F		20 KΩ NTC thermistor
<b>Options</b>						LCD	LCD display
						RLY	Relay
						NBC	No buttons



**ACCESSORY**  
A-449, Remote LCD Display allows remote indication of select Dwyer Wall Mount Transmitters for validation or certification purposes

**NEW PRODUCT!**



© 2009 Dwyer Instruments, Inc.

LEED® is a registered trademark of the U.S. Green Building Council.

AIR QUALITY  
Carbon Dioxide Transmitters